


Controlling 3 Outputs with 1 Button / PLC\_1 [CPU 1212C DC/DC/DC] / Program blocks

Main [OB1]

| Main Properties |                              |                 |               |         |             |          |     |
|-----------------|------------------------------|-----------------|---------------|---------|-------------|----------|-----|
| General         |                              |                 |               |         |             |          |     |
| Name            | Main                         | Number          | 1             | Type    | OB          | Language | LAD |
| Numbering       | Automatic                    |                 |               |         |             |          |     |
| Information     |                              |                 |               |         |             |          |     |
| Title           | "Main Program Sweep (Cycle)" | Author          |               | Comment |             | Family   |     |
| Version         | 0.1                          | User-defined ID |               |         |             |          |     |
| Main            |                              |                 |               |         |             |          |     |
| Name            |                              | Data type       | Default value |         | Supervision | Comment  |     |
| Temp            |                              |                 |               |         |             |          |     |
| Constant        |                              |                 |               |         |             |          |     |


Network 1: START SYSTEM

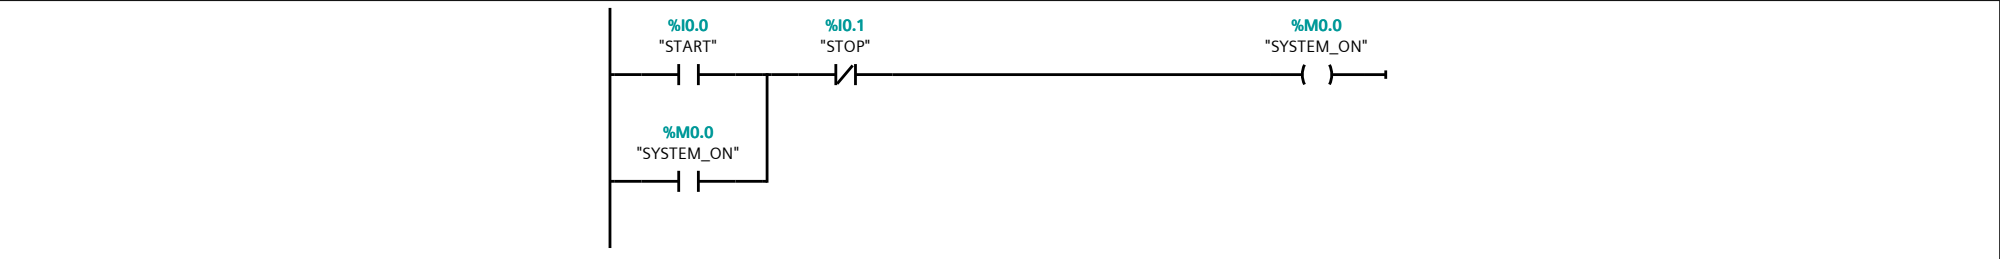


Network 2: RUN SYSTEM




Network 3: LAMP 1

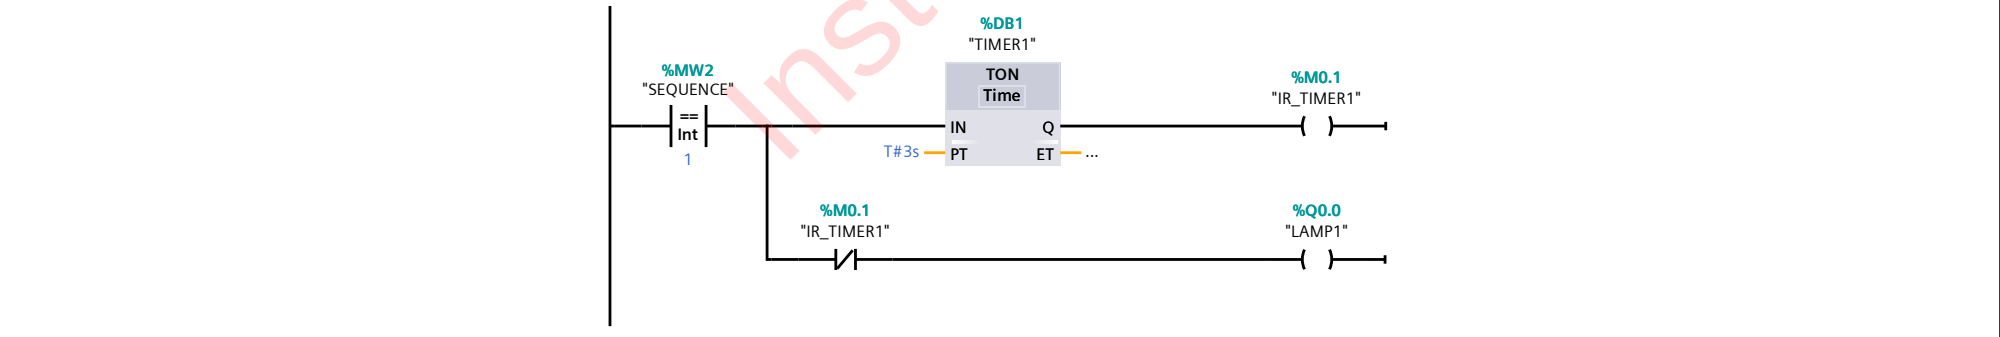


Network 4: LAMP 2

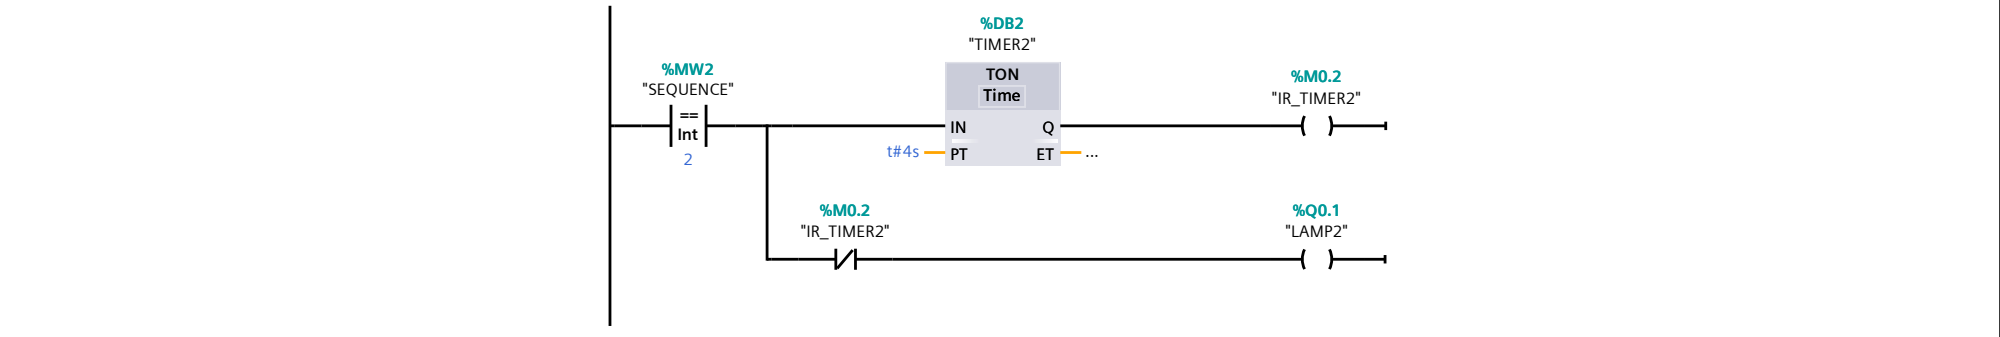

Network 5: LAMP 3

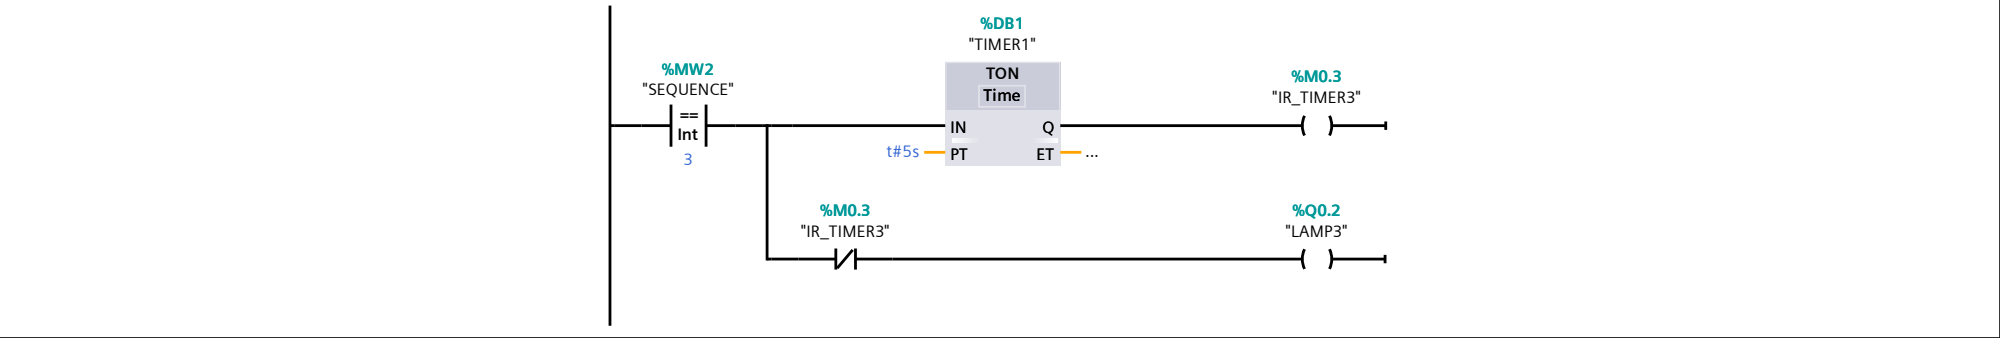

Network 6: RESET SEQUENCE

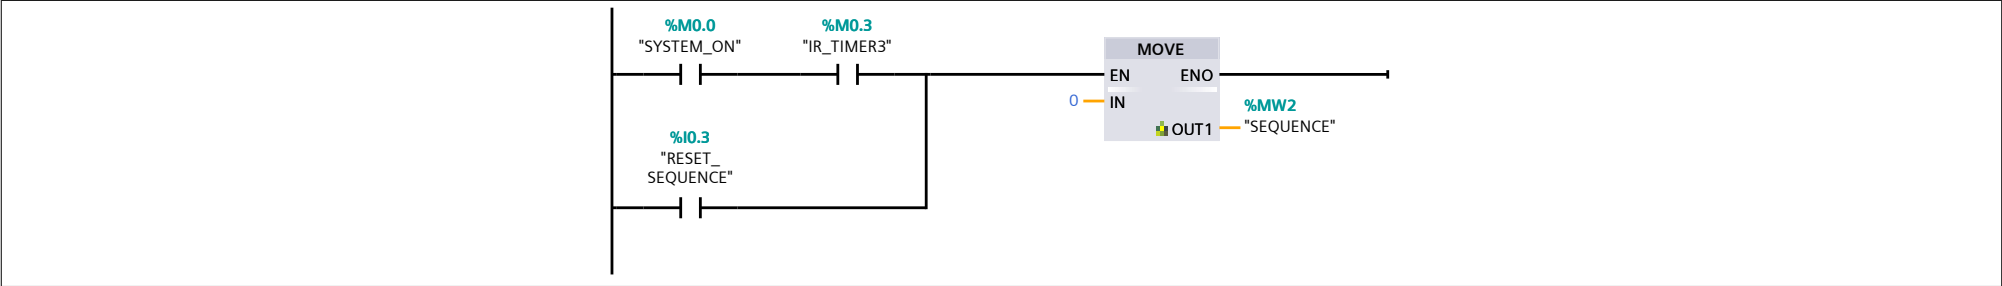

Inst Tools